




PLAN

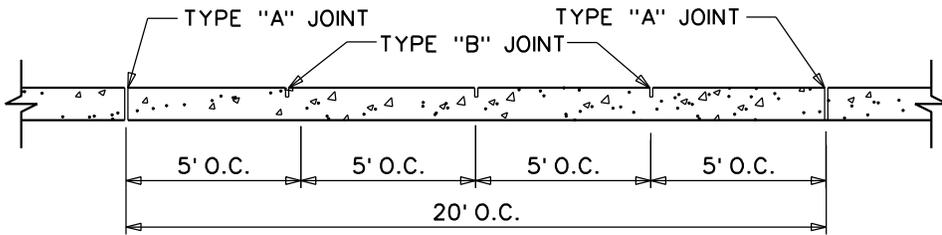

ELEVATION

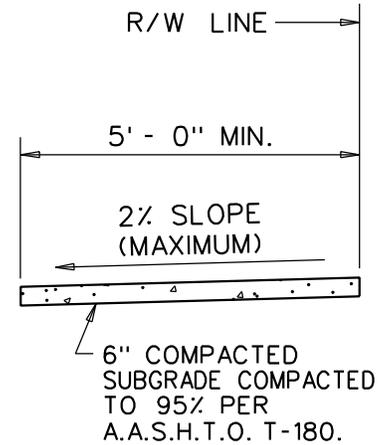

SECTION

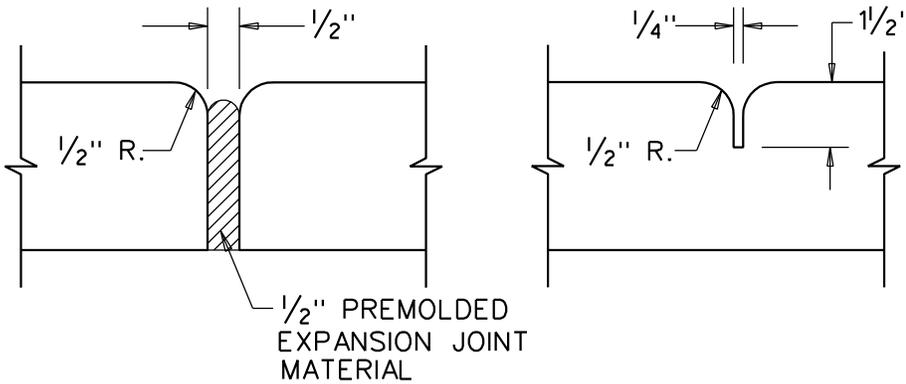

TYPE 'A'
(EXPANSION JOINTS)

TYPE 'B'
(SAWED CONTROL JOINTS)

SIDEWALK JOINTS

NOTES:

1. SIDEWALK SHALL BE 4" THICK (NO WIRE MESH) EXCEPT IN DRIVEWAYS WHERE THE THICKNESS SHALL BE 6" WITH 6 x 6 10/10 WELDED WIRE MESH.
2. CONCRETE SHALL BE 2500 P.S.I. MINIMUM COMPRESSIVE STRENGTH IN 28 DAYS

TABLE OF SIDEWALK THICKNESS	
RESIDENTIAL AREAS	4"
AT DRIVEWAYS AND OTHER AREAS	6"
TABLE OF SIDEWALK WIDTHS	
SINGLE - FAMILY AREAS	5'
MULTI - FAMILY AREAS	5'
OTHER AREAS AS SPECIFIED BY THE CITY ENGINEER.	

TABLE OF SIDEWALK JOINTS	
TYPE	LOCATION
'A'	20'-0" CENTER TO CENTER P.C. AND P.T. OF CURVES. JUNCTION OF EXISTING AND NEW SIDEWALKS. * WHERE SIDEWALK ABUTS CONCRETE CURBS, DRIVEWAYS, AND SIMILAR STRUCTURES.
'B'	5'-0" CENTER TO CENTER ON SIDEWALKS.

* AT THE DISCRETION OF THE CITY ENGINEER.

CITY OF PLANTATION
ENGINEERING STANDARDS
PLANTATION, FLORIDA

SCALE:
N.T.S.
REVISED:
SEPTEMBER, 2012

TYPICAL CONCRETE
PUBLIC SIDEWALK
DETAIL